SmartLine

Technical Information

STD700 SmartLine Differential Pressure
Specification 34-ST-03-101, March 2024



Introduction

Part of the SmartLine® family of products, the STD700 is suitable for monitoring, control and data acquisition featuring piezoresistive sensor technology. By combining pressure sensing with on chip temperature compensation capabilities STD700 offers high accuracy, stability and performance over a wide range of application pressures and temperatures. The SmartLine family is also fully tested and compliant with Experion® PKS providing the highest level of compatibility assurance and integration capabilities. SmartLine easily meets the most demanding application needs for pressure measurement applications.

Best in Class Features:

- Accuracies up to 0.05% of span standard & 0.04% of span optional.
- Stability up to 0.02% of URL per year for 10 years.
- Automatic static pressure & temperature compensation.
- Rangeability up to 100:1.
- Response times as fast as 100ms.
- Multiple local display capabilities.
- External zero, span, & configuration capability.
- Polarity insensitive electrical connections.
- Comprehensive on-board diagnostic capabilities.
- Integral Dual Seal design for highest safety based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.0.
- World class overpressure protection.
- Full compliance to SIL 2/3 requirements.
- Modular design characteristics
- Available with additional 4-year warranty

Communications/Output Options:

- Honeywell Digitally Enhanced (DE)
- HART ® (version 7.0)

All transmitters are available with the above listed communications protocols.



Figure 1 – STD700 Differential Pressure Transmitters feature field-proven piezoresistive sensor technology

Span & Range Limits:

Model	URL inH_2O (mbar)	LRL inH_2O (mbar)	Min Span inH_2O (mbar)
STD720	400 (1000)	-400 (1000)	4 (10)
Model	**psi (bar)**	**psi (bar)**	**psi (bar)**
STD730	100 (7.0)	-100 (-7.0)	1 (0.07)
STD770	3000 (210)	-100 (-7.0)	30 (2.1)

fluidic

www.fluidic-ltd.co.uk

Description

The SmartLine family pressure transmitters are designed around a high performance piezo-resistive sensor. This one sensor actually integrates multiple sensors linking process pressure measurement with on-board static pressure (DP Models) and temperature compensation measurements. This level of performance allows the ST 700 to replace most competitive transmitters available today.

Unique Indication/Display Option

The ST 700 modular design accommodates a standard alphanumeric LCD display or a unique advanced graphics LCD display with many unparalleled features.

Standard LCD Display Features

- Modular (may be added or removed in the field).
- Supports HART protocol variant.
- 0, 90,180, & 270 degree position adjustments.
- Four configurable screens.
- Standard and custom measurement units available.
- Display calculated flow (square root) value in addition to analog output signal.
- 2 Lines 6 digits PV (9.95H x 4.20W mm) 8 Characters.
- Write protect Indication.
- Built-in Basic Device Configuration through Internal or External Buttons – Range/Engineering Unit/Loop Test /Loop Calibration/Zero /Span Setting.
- Multiple language capabilities (EN, RU).

Advanced LCD Display Features

- Modular (may be added or removed in the field)
- 0, 90,180, & 270 degree position adjustments.
- Standard and custom measurement units available.
- Up to eight display screens with 3 formats are possible.
- Large PV with Bar Graph or PV with Trend Graph.
- Configurable screen rotation timing (1 to 30 sec).
- Display calculated flow (square root) value in addition to analog output signal.
- Unique “Health Watch” indication provides instant visibility of diagnostics.
- Multiple language capability (EN, DE, FR, IT, ES, RU, TR, CN, & JP).

Diagnostics

SmartLine transmitters all offer digitally accessible diagnostics which aid in providing advanced warning of possible failure events minimizing unplanned shutdowns, providing lower overall operational costs.

System Integration

- SmartLine communications protocols all meet the most current published standards for HART/DE.
- Integration with Honeywell’s Experion PKS offers the following unique advantages.
  - Tamper reporting
  - FDM Plant Area Views with Health summaries
  - All ST 700 units are Experion tested to provide the highest level of compatibility assurance.

Configuration Tools

Integral Three Button Configuration Option

Suitable for all electrical and environmental requirements, SmartLine offer the ability to configure the transmitter and display via three externally accessible buttons when either display option is selected. Zero/span capabilities are also optionally available via these buttons with or without selection of a display option.

Handheld Configuration

SmartLine transmitters feature two-way communication and configuration capability between the operator and the transmitter. All Honeywell transmitters are designed and tested for compliance with the offered communication protocols and are designed to operate with any standards compliant handheld configuration device, such as Honeywell Versatilis Configurator.

Personal Computer Configuration

On a personal computer or laptop, Honeywell Field Device Manager (FDM) Software and FDM Express can be used for managing HART device configurations.

Modular Design

To help contain maintenance & inventory costs, all ST 700 transmitters are modular in design supporting the user’s ability to replace meter bodies, add indicators or change electronic modules without affecting overall performance or approval body certifications. Each meter body is uniquely characterized to provide in-tolerance performance over a wide range of application variations in temperature and pressure and due to the Honeywell advanced interface, electronic modules may be swapped with any electronics module without losing in-tolerance performance characteristics.

Modular Features

- Meter body replacement
- Exchange/replace electronics/comms modules*
- Add or remove integral indicator*
- Add or remove lightning protection (terminal connection)*

* Field replaceable in all electrical environments (including IS) except flameproof without violating agency approvals.

With no performance effects, Honeywell’s unique modularity results in ***lower inventory needs and lower overall operating costs.***

Performance Specifications

Reference Accuracy (conformance to +/-3 Sigma)

Table 1

Model	URL	LRL	Min Span	Maximum Turndown Ratio	Stability (% URL/Year for 10 years)	Reference Accuracy[1,2] (% Span) Standard/ optional
STD720	400 in H_2O (1000 mbar)	-400 in H_2O (-1000 mbar)	4 in H_2O (10 mbar)	100:1	0.020	0.05 / 0.04
STD730	100 psi (7.0 bar)	-100 psi (-7.0 bar)	1 psi (0.07 bar)	100:1	0.020	
STD770	3000 psi (210 bar)	-100 psi (-7.0 bar)	30 psi (2.1bar)	100:1	0.020	

Table 1

Zero and span may be set anywhere within the listed (URL/LRL) range limits

Accuracy at Specified Span, Temperature and Static Pressure Effects: (conformance to +/-3)

Table 2

			Accuracy[1,2] (% of Span)				Combined Zero & Span temperature Effect (% Span / 28°C (50°F))		Combined Zero & Span Static Line Pressure Effect (% Span/1000psi)	
	Model	URL	Reference Turndown	A	B	C (see URL units)	D	E	F	G
Standard Accuracy	STD720	400 in H_2O (1000 mbar)	16:1	0.005	0.045	25 (62.5)	0.050	0.020	0.100	0.010
	STD730	100 psi (7.0 bar)	4:1			25 (1.75)	0.065	0.010		
	STD770	3000 psi (210 bar)	10:1			300 (21)				
High Accuracy option	STD720	400 in H_2O (1000 mbar)	16:1	0.005	0.035	25 (62.5)	0.050	0.020	0.100	0.010
	STD730	100 psi (7.0 bar)	4:1			25 (1.75)	0.065	0.010		
	STD770	3000 psi (210 bar)	10:1			300 (21)				
			Turn Down Effect				Temp Effect		Static Effect	
			$\pm[A+B] \quad if\ Span \geq C$ $\pm\left[A+B\left(\frac{C}{Span}\right)\right] \quad if\ Span < C$				$\pm[D+E\left(\frac{URL}{Span}\right)]$		$\pm[F+G\left(\frac{URL}{Span}\right)]$	

Total Performance (% of Span):

Total Performance = **+/-**
$\sqrt{}$(Accuracy)² + (Temp Effect)²+ (Static Line Pressure Effect)²

Total Performance Examples (for comparison): standard accuracy, 5:1 Turndown, up to 50°F (28°C) shift & up to 1000 psi Static Pressure

STD720 @ 80 inH_2O: 0.218% of span

STD730 @ 20 psi: 0.199 % of span

STD770 @ 600 psi: 0.196 % of span

Typical Calibration Frequency:

Calibration verification is recommended every two (2) years.

Notes:

1. Terminal Based Accuracy – Includes combined effects of linearity, hysteresis and repeatability. Analog output adds 0.005% of span.
2. For zero based spans and reference conditions of: 25°C (77°F), 0 psig static pressure, 10 to 55% RH and 316SS barrier diaphragm.

Operating Conditions – All Models

Parameter	Reference Condition		Rated Condition		Operative Limits		Transportation and Storage	
	°C	°F	°C	°F	°C	°F	°C	°F
Ambient Temperature[1]	25±1	77±2	-40 to 85	-40 to 185	-40 to 85	-40 to 185	-55 to 120	-67 to 248
Meter Body Temperature[2]	25±1	77±2	-40 to 110	-40 to 230	-40 to 125	-40 to 257	-55 to 120	-67 to 248
Humidity %RH	10 to 55		0 to 100		0 to 100		0 to 100	
Vac. Region – Min. Pressure **mmHg absolute** **inH$_2$O absolute**	Atmospheric Atmospheric		25 13		2 (short term) [3] 1 (short term) [3]			
Supply Voltage Load Resistance	HART: 10.8 to 42.4 VDC at terminals (IS versions limited to 30 VDC), 0 to 1,440 ohms DE: 15 to 49.3VDC at terminals (IS versions limited to 30VDC), 0 to 1,200 ohms (as shown in Figure 2)							
Maximum Allowable Working Pressure (MAWP)[4,5] (ST 700 products are rated to Maximum Allowable Working Pressure. MAWP depends on Approval Agency and transmitter materials of construction.)	4,500 psi (310 bar)							

[1] LCD Display operating temperature -20°C to +70°C. Storage temperature -30°C to 80°C.

[2] Silicone 704 minimum temperature rating is 0ºC (32ºF). CTFE minimum temperature rating is -40°C (-40°F). NEOBEE® M-20 minimum temperature rating is -15ºC (5ºF). NEOBEE® is a registered trademark of Stepan Company.

[3] Short term equals 2 hours at 70°C (158°F).

[4] MAWP applies for temperatures -40 to 125°C. Static Pressure Limit is de-rated to 3,000 psi for -26°C to -40°C. for all models. Use of graphite o-rings de-rates transmitter to 3,625 psi. Use of 1/2:" process adaptors with graphite o-rings de-rates transmitter to 3,000 psi.

[5] Consult factory for MAWP of ST 700 transmitters with CRN approval.

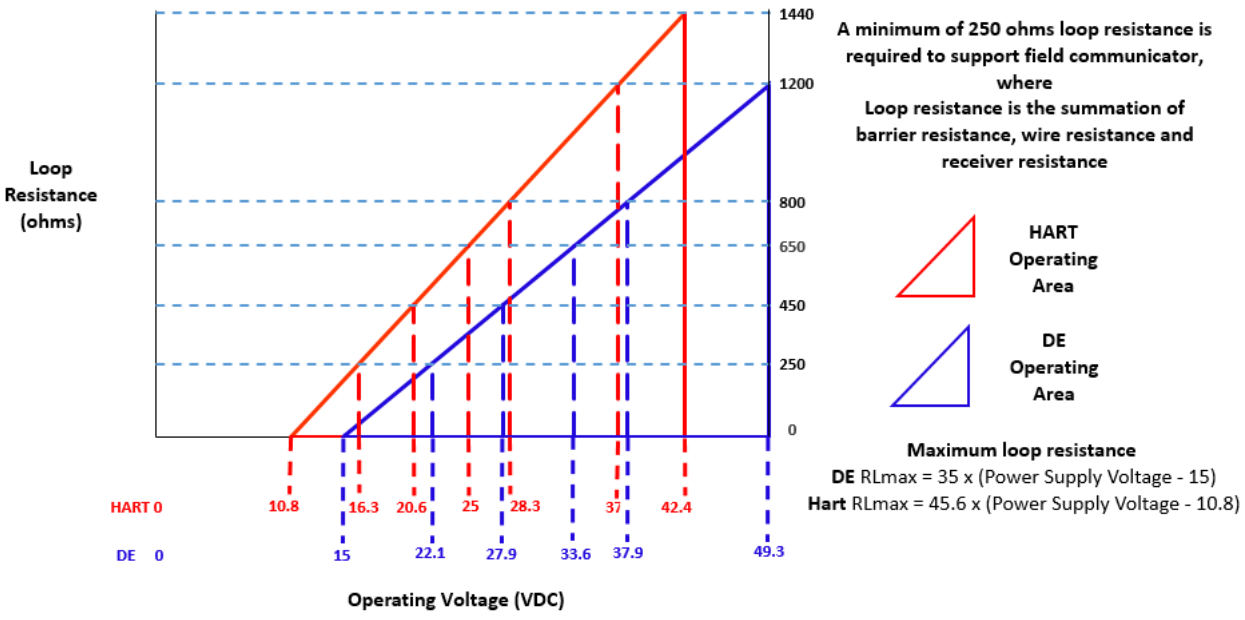


Figure 2 - Supply voltage and loop resistance chart & calculations

Performance Under Rated Conditions – All Models

Parameter	Description
Analog Output **Digital Communications**:	Two-wire, 4 to 20 mA (HART & DE Transmitters only) Honeywell DE, HART protocol. All transmitters, irrespective of protocol have polarity insensitive connections.
HART & DE Output Failure Modes (NAMUR for DE Units requires selecting display and configuration buttons or factory configuration)	**Honeywell Standard** / **NAMUR NE 43 Compliance** **Normal Limits:** 3.8 – 20.8 mA / 3.8 – 20.5 mA **Failure Mode:** ≤ 3.6 mA and ≥ 21.0 mA / ≤ 3.6 mA and ≥ 21.0 mA
Supply Voltage Effect	0.005% span per volt.
Transmitter Turn on Time (includes power up & test algorithms)	HART or DE: 2.5 secconds
Response Time (delay + time constant)	**DE/HART Analog Output** 100ms
Damping Time Constant	**HART:** Adjustable from 0 to 32 seconds in 0.1 increments. **Default:** 0.50 seconds **DE:** Discrete values 0, .16, .32, .48, 1, 2, 4, 8, 16, 32 seconds. **Default:** 0.48 seconds
Vibration Effect	Less than +/- 0.1% of URL w/o damping Per IEC60770-1 field or pipeline, high vibration level (10-2000Hz: 0.21 displacement/3g max acceleration)
Electromagnetic Compatibility	IEC 61326-3-1
Lightning Protection Option	**Leakage Current:** 10uA max @ 42.4VDC 93C **Impulse rating:** 8/20us 5000A (>10 strikes) 10000A (1 strike min.) 10/1000us 200A (> 300 strikes)

Materials Specifications (see model selection guide for availability/restrictions with various models)

Parameter	Description
Barrier Diaphragms Material	316L SS, Hastelloy® C-276[2], Monel® 400 [3], Tantalum
Process Head Material	316 SS[4], Carbon Steel (Zinc-plated) [5], Hastelloy C-276[6]
Vent/Drain Valves & Plugs [1]	316 SS[4], Hastelloy C-276[2]
Head Gaskets	Glass-filled PTFE standard. Viton® and graphite are optional.
Meter Body Bolting	Carbon Steel (Zinc plated) standard. Options include 316 SS, NACE A286 SS bolts, Monel K500, Super Duplex and B7M.
Optional Adapter Flange and Bolts	Adapter Flange materials include 316 SS, Hastelloy C-276 and Monel 400. Bolt material for flanges is dependent on process head bolts material chosen. Standard adaptor seal material is glass-filled PTFE. Viton and graphite are optional.
Mounting Bracket	2” Pipe, Carbon Steel (Zinc-plated) or 304 Stainless Steel or 316 Stainless Steel
Fill Fluid	Silicone 200, CTFE, NEOBEE M-20 or Silicone 704.
Electronic Housing	Pure Polyester Powder Coated Low Copper (<0.4%) – Aluminum. Meets Type 4X / IP66 / IP67. All stainless-steel housing is optional. Cover O ring material: Silicone.
Mounting	Can be mounted in virtually any position using the standard mounting bracket. Bracket is designed to mount on 2-inch (50 mm) vertical or horizontal pipe. See Figure 3.
Process Connections	1/4- NPT or 1/2- NPT with adapter (meets DIN requirements)
Wiring	Accepts up to 16 AWG (1.5 mm diameter).
Dimensions	See Figure 4.
Net Weight	8.3 pounds (3.8 Kg) with Aluminum Housing.

[1] Vent/Drains are sealed with Teflon®

[2] Hastelloy C-276 or UNS N10276

[3] Monel 400 or UNS N04400

[4] Supplied as 316 SS or as Grade CF8M, the casting equivalent of 316 SS.

[5] Carbon Steel heads are zinc-plated and not recommended for water service due to hydrogen migration. For that service, use 316 stainless steel wetted Process Heads.

[6] Hastelloy C-276 or UNS N10276. Supplied as indicated or as Grade CW12MW, the casting equivalent of Hastelloy C-276

Communications Protocols & Diagnostics

HART Protocol

Version: HART 7

Honeywell Digitally Enhanced (DE)

DE is a Honeywell proprietary protocol which provides digital communications between Honeywell DE enabled field devices and hosts.

Standard Diagnostics

ST 700 top level diagnostics are reported as either critical or non-critical and are readable via the DD/DTM/FDI tools or integral display. All critical diagnostics will appear on the Advanced and Standard integral displays, and some non-critical diagnostics will also appear on the Advanced integral display. Some of the diagnostics are listed below.

Critical Diagnostics

- Electronics Module Fault.
- Meter body Memory Corruption.
- Config Data Corruption.
- Electronics Module Diagnostics Failure.
- Meter body Critical Failure.
- Sensor Communication Timeout.

Non-Critical Diagnostics

- Electronics Module Fault.
- Display Failure.
- Electronics Module Comm Failure.
- Meter body Excess Correct.
- Sensor Over Temperature.
- Fixed Current Mode.
- PV Out of Range.
- No DAC Compensation.
- Tamper Attempt Alarm.

Refer to the product user manual for comprehensive list of diagnostics and details.

Hazardous Areal Certifications

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
A	FM Approvals™ USA	**Explosionproof:** Class I, Division 1, Groups A, B, C, D; Dust Ignition Proof: Class II, III, Division 1, Groups E, F, G; T6..T5 Class I, Zone 0/1, AEx db IIC T6..T5 Ga/Gb Class II, Zone 21, AEx tb IIIC T95° Db	All	Note 1	T5: -50 ºC to 85ºC T6: -50 ºC to 65ºC
		Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D, E, F, G: T4 Class I, Zone 0, AEx ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2a	-50 ºC to 70ºC
			Foundation Fieldbus	Note 2b	-50 ºC to 70ºC
		Nonincendive: Class I, Division 2, Groups A, B, C, D locations, T4 Class I, Zone 2, AEx nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 ºC to 85ºC
		Enclosure: Type 4X/ IP66/ IP67	All	All	-
		STANDARDS: FM Class 3600:2011; FM Class 3610: 2010; FM Class 3611: 2004; FM Class 3615: 2006; FM Class 3616: 2011; FM Class 3810: 2005; ANSI/ISA 60079-0: 2013; ANSI/UL 60079-1: 2015; ANSI/UL 60079-11: 2014; ANSI/ISA 60079-15: 2012; ANSI/UL 60079-26: 2017; ANSI/UL 60079-31: 2015; ANSI/NEMA 250: 2003; ANSI/ IEC 60529: 2004			
B	Canadian Standards Association (CSA) USA and Canada	**Explosion Proof:** Class I, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1, T6..T5 Class I Zone 1 AEx db IIC T6..T5 Ga/Gb Ex db IIC T6..T5 Ga/Gb Zone 22 AEx tb IIIC T95° Db Ex tb IIIC T95° Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1, T4 Class I Zone 0, AEx ia IIC T4 Ga Class I Zone 2, AEx ic IIC T4 Gc Ex ia IIC T4 Ga Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Nonincendive: Class I, Division 2, Groups A, B, C, D; Class II, Division 2, Groups F, G; Class III, Division 2, T4 Class I Zone 2 AEx nA IIC T4 Gc Ex nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C to 85°C
		Enclosure: Type 4X/ IP66/ IP67	All	All	-

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
		STANDARDS: CSA C22.2 No. 0-10; CSA C22.2 No. 94-M91; CSA C22.2 No. 25-1966; CSA C22.2 No. 30-M1986; CSA C22.2 No. 142-M1987; CSA C22.2 No. 157-92; CSA C22.2 No. 213-M1987; CSA-C22.2 No. 60529:05; CSA-C22.2 No. 60079-0:11; CSA-C22.2 No. 60079-1:11; CSA-C22.2 No. 60079-11:11; CSA-C22.2 No. 60079-15:12; CSA-C22.2 No. 60079-31:12; ISA 12.12.01-2010; ISA 60079-0: 2009; ISA 60079-11: 2011; ISA 60079-15: 2009; ISA 60079-26: 2008; ISA-60079-27:2007 (12.02.04)-2006 (R2011); UL 913 Ed. 6; UL 916:1998; ANSI/ISA-12.27.01-2011			
C	**ATEX**	**Flameproof: SIRA 12ATEX2233X** II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: SIRA 12ATEX2233X II 1 G Ex ia IIC T4 Ga II 2 D Ex ia IIIC T125°C Db FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: SIRA 12ATEX4234X II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: SIRA 12ATEX4234X II 3 G Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) II 3 G Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
		STANDARDS: EN 60079-0: 2018; EN 60079-1: 2014; EN 60079-7: 2015+A1:2018; EN 60079-11: 2012; EN 60079-26: 2015; EN 60079-31: 2014			
	UKEx	**Flameproof: CSAE 22UKEX1021X** II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: CSAE 22UKEX1021X II 1 G Ex ia IIC T4 Ga II 2 D Ex ia IIIC T125°C Db FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: CSAE 22UKEX1008X II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: CSAE 22UKEX1009X II 3 G Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) II 3 G Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
		STANDARDS: EN 60079-0: 2018; EN 60079-1: 2014; EN 60079-7: 2015+A1:2018; EN 60079-11: 2012; EN 60079-26: 2015; EN 60079-31: 2014			
D	**IECEx World**	**Flameproof: IECEx SIR 12.0100X** Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: IECEx SIR 12.0100X Ex ia IIC T4 Ga Ex ia IIIC T125°C Db FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: IECEx SIR 12.0100X Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: IECEx SIR 12.0100X Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
		STANDARDS: IEC 60079-0: 2017; IEC 60079-1: 2014; IEC 60079-7: 2017; IEC 60079-11: 2011; IEC 60079-26: 2014; IEC 60079-31: 2013			
E	**SAEx South Africa**	**Flameproof :** Ex d IIC T6…T5 Ga/Gb Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC Ga T4 FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
F	INMETRO Brazil	**Flameproof:** Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2a	-50°C TO 70°C
		FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	Foundation Fieldbus	Note 2b	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	-
G	NEPSI CHINA	**Flameproof:** Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T 95°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	-
H	KOSHA Korea	**Flameproof :** Ex d IIC T4, T5, T6 Ex tD A21 IP66/IP67 T95°C…T120 °C	All	Note 1	T4: -50°C TO 85°C T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4	4-20 mA / DE/ HART	Note 2	Ta= -50 ºC to 70ºC
			Foundation Fieldbus	Note 2	Ta= -50 ºC to 70ºC
		Enclosure: IP66/ IP67	All	All	-
I	EAC Russia, Belarus and Kazakhstan	**Flameproof:** Ga/Gb Ex d IIC T6..T5 Ex tb IIIC Db T 85°C	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ga Ex ia IIC T4 X	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C

		FISCO Field Device (Only for FF Option) Ga Ex ia IIC T4 X	Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Non Sparking: 2 Ex nA IIC T4 Gc X	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ga Ex ic IIC T4 X FISCO Field Device (Only for FF Option) 2 Ex ic IIC T4 Gc X	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	
J	**CCoE INDIA**	**Flameproof:** Ex d IIC T6..T5 Ga/Gb	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Non Sparking Ex nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
K	**UATR UKRAINE**	**Flameproof:** II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C…T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: II 1 G Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Enclosure: IP66/ IP67	All	All	-

Notes:

1. Operating Parameters:
   Voltage = 11 to 42 VDC Current = 4-20 mA Normal
   = 9 to 32 V (FF) = 30 mA (FF)
2. Intrinsically Safe Entity Parameters
   a. Analog/ DE/ HART Entity Values:
   Vmax = Ui = 30V Imax = Ii = 105mA Ci = 4.2nF Li = 984 uH Pi = 0.9W

   Transmitter with Terminal Block Revision E or Later
   Vmax = Ui = 30V Imax = Ii = 225mA Ci = 4.2nF Li = 0 Pi = 0.9W
   Note: Transmitter with Terminal Block Revision E or later
   The revision is on the label that is on the module. There will be two lines of text on the label:
   - First is the Module Part #: 50049839-001 or 50049839-002
   - Second line has the supplier information, along with the REVISION:
     XXXXXXX-EXXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION.

   b. Foundation Fieldbus Entity Values
   Vmax = Ui = 30V Imax= Ii = 180mA Ci = 0nF Li = 984 uH Pi = 1W

   Transmitter with Terminal Block Revision F or Later
   Vmax = Ui = 30V Imax = Ii = 225mA Ci = 0nF Li = 0 Pi = 1 W
   FISCO Field Device
   Vmax = Ui = 17.5V Imax = Ii = 380 mA Ci = 0nF Li = 0 Pi = 5.32 W
   Note: Transmitter with Terminal Block Revision F or later
   The revision is on the label that is on the module. There will be two lines of text on the label:
   - First is the Module Part #: 50049839-003 or 50049839-004
   - Second line has the supplier information, along with the REVISION:
     XXXXXXX-EXXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION.

Approval Certifications

Marine Certificates	This certificate defines the certifications covered for the ST 800 Pressure Transmitter family of products, including the SMV 800 Smart Multivariable Transmitter. It represents the compilation of the five certificates Honeywell currently has covering the certification of these products into marine applications. For SmartLine Pressure Transmitter and SMV800 Smart Multivarible Transmitter
	American Bureau of Shipping (ABS) - 2009 Steel Vessel Rules 1-1-4/3.7, 4-6-2/5.15, 4-8-3/13 & 13.5, 4-8-4/27.5.1, 4-9-7/13. Certificate number: 04-HS417416-PDA
	Bureau Veritas (BV) - Product Code: 389:1H. Certificate number: 12660/B0 BV
	Det Norske Veritas (DNV) - Location Classes: Temperature D, Humidity B, Vibration A, EMC B, Enclosure C. For salt spray exposure; enclosure of 316 SST or 2-part epoxy protection with 316 SST bolts to be applied. Certificate number: A-11476
	Korean Register of Shipping (KR) - Certificate number: LOX17743-AE001
	Lloyd's Register (LR) - Certificate number: 02/60001(E1) & (E2)
SIL 2/3 Certification	IEC 61508 SIL 2 for non-redundant use and SIL 3 for redundant use according to EXIDA and TÜV Nord Sys Tec GmbH & Co. KG under the following standards: IEC61508-1: 2010; IEC 61508-2: 2010; IEC61508-3: 2010.

Other Certification Options

Materials

NACE MRO175, MRO103, ISO15156

Mounting & Dimensional Drawings

Reference Dimensions: millimeters / inches

Mounting Configurations

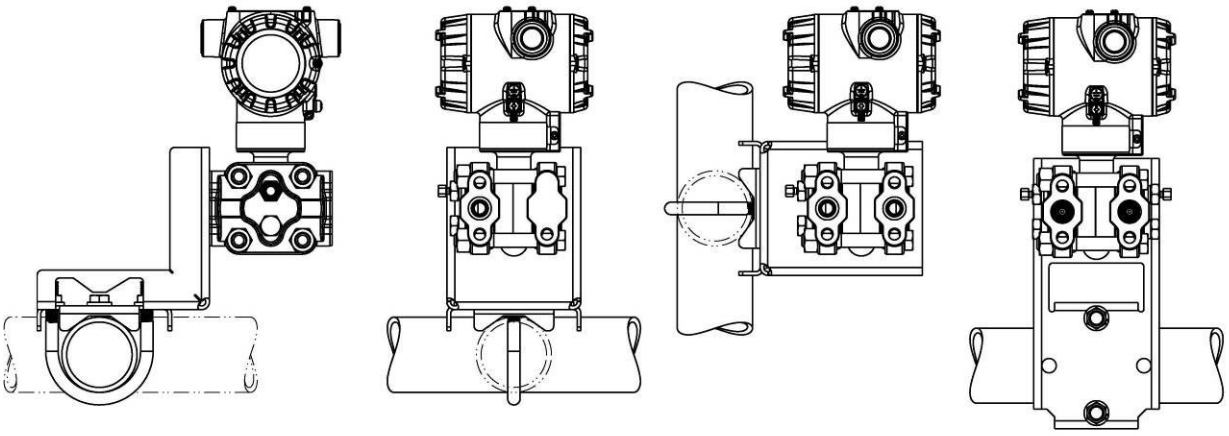


Figure 3 – Typical mounting configurations of STD720, STD730 & STD770 for reference only

Dimensions

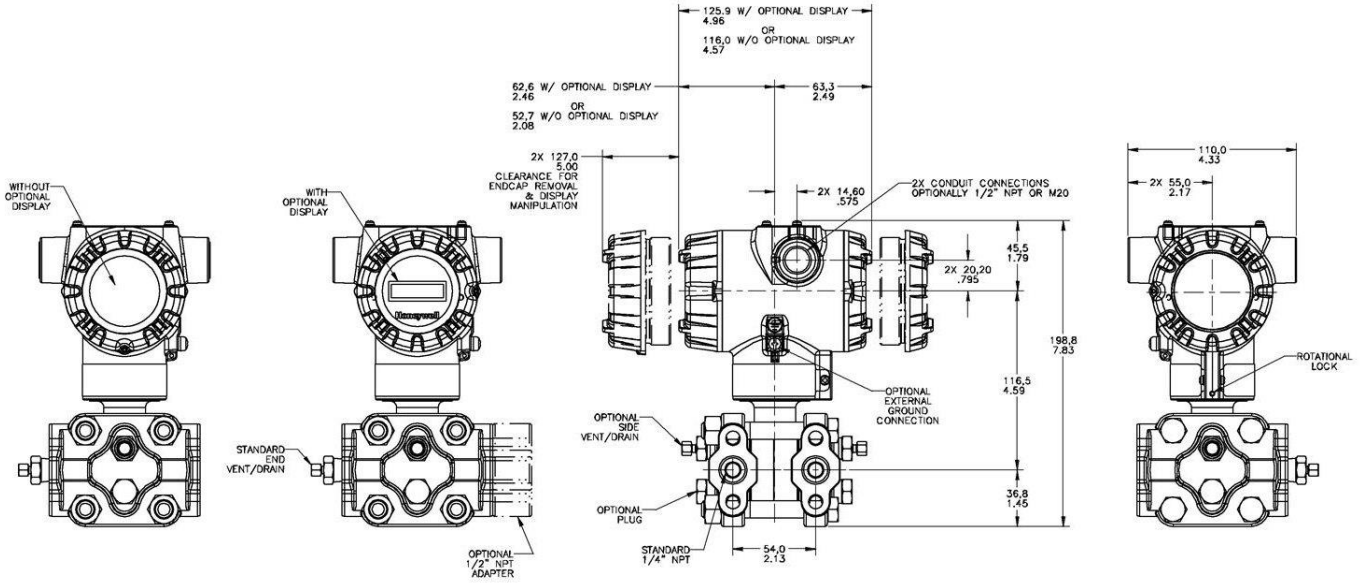


Figure 4 – Typical mounting dimensions of STD720, STD730 & STD770 for reference only

Model Selection Guide

Model Selection Guides are subject to change and are inserted into the specifications as guidance only.

Model STD700
Differential Pressure Transmitter

Model Selection Guide:
34-ST-16-101, Issue 35

Instructions: Make selections from all Tables: Key through XIII using column below the proper arrow. Asterisk indicates availability. Letter (a) refer to restrictions highlighted in the restrictions table. Tables delimited with dashes.
List Price: Price equals the sum of prices for all selections made.

Key | I | II | III | IV | V | VI | VII | VIII | IX
STD ___ - _ _ _ _ _ _ _ - _ - _ - _ _ _ - _ _ _ - _ - _ _ _ _ - __.__.__ - 0 0 0 0


KEY NUMBER	URL	LRL	Max Span	Min Span	Units
a. Measurement Range	400/(1000)	-400/(-1000)	400/(1000)	4.0 (10)	" H_2O (mbar)
	100 (7.0)	-100 (-7.0)	100 (7.0)	1 (0.07)	psi (bar)
	3000 (210)	-100 (-7.0)	3000 (210)	30 (2.1)	psi (bar)

Selection	Availability		
STD720	↓		
STD730		↓	
STD770			↓

TABLE I	METER BODY SELECTIONS			
a. Process Wetted Heads & Diaphragm Materials	Process Head Material	Diaphragm Material		
	Plated Carbon Steel	316L Stainless Steel		
		Hastelloy® C-276		
		Monel® 400		
		Tantalum		
	316 Stainless Steel	316L Stainless Steel		
		Hastelloy C-276		
		Monel 400		
		Tantalum		
	Hastelloy C-276	Hastelloy C-276		
		Tantalum		
	Monel 400	Monel® 400		
b. Fill Fluid	Silicone Oil 200			
	Fluorinated Oil CTFE			
	Silicone Oil 704			
	NEOBEE® M-20			
c. Process Connection	None	None (1/4" NPTF female thread Std)		
	1/2" NPT female	Materials to Match Head & Head Bolt Materials Selections[1]		
d. Bolt/Nut Materials	Carbon Steel			
	316 SS			
	Grade 660 (NACE A286) with NACE 304 SS Nuts			
	Grade 660 (NACE A286) Bolts & Nuts			
	Monel K500			
	Super Duplex			
	B7M			
e. Vent/Drain Type/Location	Head Type	Vent Type	Location	Vent Material
	Single Ended	None	None	None
	Single Ended	Standard Vent	Side	Matches Head Material[1]
	Single Ended	Center Vent	Side	Stainless Steel Only
	Dual Ended	Standard Vent	End	Matches Head Material[1]
	Dual Ended	Center Vent	End	Stainless Steel Only
	Dual Ended	Std Vent/Plug	Side/End	Matches Head Material[1]
f. Gasket Material	Teflon® or PTFE (Glass Filled)			
	Viton® or Fluorocarbon Elastomer			
	Graphite			
g. Static Pressure	Standard Static Pressure - 4500 psig (315 bar)			

A _ _ _ _ _	*	*	*
B _ _ _ _ _	*	*	*
C _ _ _ _ _	*	*	*
D _ _ _ _ _	**a**	**a**	**a**
E _ _ _ _ _	*	*	*
F _ _ _ _ _	*	*	*
G _ _ _ _ _	*	*	*
H _ _ _ _ _	**a**	**a**	**a**
J _ _ _ _ _	*	*	*
K _ _ _ _ _	**a**	**a**	**a**
L _ _ _ _ _	**a**	**a**	**a**
_ 1 _ _ _ _	*	*	*
_ 2 _ _ _ _	*	*	*
_ 3 _ _ _ _	*	*	*
_ 4 _ _ _ _	*	*	*
_ _ A _ _ _	*	*	*
_ _ H _ _ _	*	*	*
_ _ _ C _ _ _	*****	*****	*****
_ _ _ S _ _ _	*****	*****	*****
_ _ _ N _ _ _	*	*	*
_ _ _ K _ _ _	**p**	**p**	**p**
_ _ _ M _ _ _	**p**	**p**	**p**
_ _ _ D _ _ _	**p**	**p**	**p**
_ _ _ B _ _ _	*	*	*
_ _ _ _ 1 _ _	*	*	*
_ _ _ _ 2 _ _	*	*	*
_ _ _ _ 3 _ _	**t**	**t**	**t**
_ _ _ _ 4 _ _	*	*	*
_ _ _ _ 5 _ _	**t**	**t**	**t**
_ _ _ _ 6 _ _	*	*	*
_ _ _ _ _ A _	*	*	*
_ _ _ _ _ B _	*	*	*
_ _ _ _ _ C _	*	*	*
_ _ _ _ _ _S	*	*	*

[1]Except Carbon Steel Heads shall use 316SS Vent/Drain, Plugs & Adapters when required

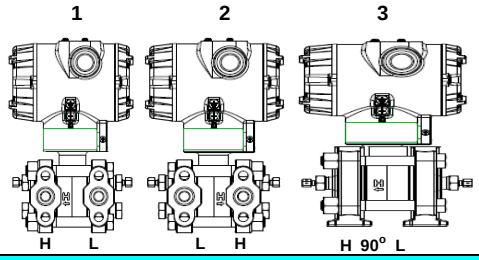

			STD770	STD730	STD720
TABLE II	**Meter Body & Connection Orientation**				
Head/Connect Orientation	Standard	High Side Left, Low Side Right[2] / Std Head Orientation	1	*	*	*
	Reversed	Low Side Left, High Side Right[2] / Std Head Orientation	2	*	*	*
	90/Standard	High Side Left, Low Side Right[2] / 90° Head Rotation	3	**h**	**h**	**h**

TABLE III	**Agency Approvals (see data sheet for Approval Code Details)**				
Approvals	No Approvals Required		0	*	*	*
	FM Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof		A	*	*	*
	CSA Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof		B	*	*	*
	ATEX Explosion proof, Intrinsically Safe & Non-incendive		C	*	*	*
	IECEx Explosion proof, Intrinsically Safe & Non-incendive		D	*	*	*
	SAEx Explosion proof, Intrinsically Safe & Non-incendive		E	*	*	*
	INMETRO Explosion proof, Intrinsically Safe & Non-incendive		F	*	*	*
	NEPSI Explosion proof, Intrinsically Safe & Non-incendive		G	*	*	*
	KOSHA Explosion proof, Intrinsically Safe & Non-incendive		H	*	*	*
	EAC Customs Union (Russia,Belarus,Kazakhstan) Ex Approval Flame proof, Intrinsically Safe		I	*	*	*
	ATEX/IECEx Explosion proof, Intrinsically Safe & Non-incendive		1	*	*	*
	CCoE Explosion proof, Intrinsically Safe & Non-incendive		J	*	*	*
	UATR Flameproof, Intrinsically Safe & Dustproof		K	*	*	*

TABLE IV	**TRANSMITTER ELECTRONICS SELECTIONS**					
a. Electronic Housing Material & Connection Type	**Material**	**Connection**	**Lightning Protection**			
	Polyester Powder Coated Aluminum	1/2 NPT	None	A _ _	*	*	*
	Polyester Powder Coated Aluminum	M20	None	B _ _	*	*	*
	Polyester Powder Coated Aluminum	1/2 NPT	Yes	C _ _	*	*	*
	Polyester Powder Coated Aluminum	M20	Yes	D _ _	*	*	*
	316 Stainless Steel (Grade CF8M)	1/2 NPT	None	E _ _	*	*	*
	316 Stainless Steel (Grade CF8M)	M20	None	F _ _	*	*	*
	316 Stainless Steel (Grade CF8M)	1/2 NPT	Yes	G _ _	*	*	*
	316 Stainless Steel (Grade CF8M)	M20	Yes	H	*	*	*
b. Output/ Protocol	**Analog Output**		**Digital Protocol**			
	4-20mA dc		HART Protocol	_ H _	*	*	*
	4-20mA dc		DE Protocol	_ D _	*	*	*
c. Customer Interface Selections	**Indicator**	**Ext Zero, Span & Config Buttons**	**Languages**			
	None	None	None	_ _ 0	*	*	*
	None	Yes (Zero/Span Only)	None	_ _ A	*	*	*
	Advanced	None	EN, GE, FR, IT, SP, RU, TU	_ _ D	*	*	*
	Advanced	Yes	EN, GR, FR, IT, SP, RU, TU	_ _ E	*	*	*
	Advanced	None	EN, CH, JP	_ _ H	*	*	*
	Advanced	Yes	EN, CH, JP	_ _ J	*	*	*
	Standard (w/internal Zero, Span & Conf Buttons)	None	EN, RU	_ _ S	**u**	**u**	**u**
	Standard (w/internal Zero, Span & Conf Buttons)	Yes	EN, RU	_ _ T	**u**	**u**	**u**

TABLE V	**CONFIGURATION SELECTIONS**					
a. Application Software	**Diagnostics**					
	Standard Diagnostics			1 _ _	*	*	*
b. Output Limit, Failsafe & Write Protect Settings	**Write Protect**	**Fail Mode**	**High & Low Output Limits[3]**			
	Disabled	High> 21.0mAdc	Honeywell Std (3.8 - 20.8 mAdc)	_ 1 _	*	*	*
	Disabled	Low< 3.6mAdc	Honeywell Std (3.8 - 20.8 mAdc)	_ 2 _	*	*	*
	Enabled	High> 21.0mAdc	Honeywell Std (3.8 - 20.8 mAdc)	_ 3 _	*	*	*
	Enabled	Low< 3.6mAdc	Honeywell Std (3.8 - 20.8 mAdc)	_ 4 _	*	*	*
c. General Configuration	Factory Standard			_ _ S	*	*	*
	Custom Configuration (Unit Data Required from customer)			_ _ C	*	*	*

[2] Left side/Right side as viewed from the customer connection perspective

[3] NAMUR Output Limits 3.8 - 20.5mAdc can be configured by the customer or select custom configuration Table Vc

TABLE VI	CALIBRATION & ACCURACY SELECTIONS			STD770	STD730	STD720
	Accuracy	**Calibrated Range**	**Calibration Qty**			
Accuracy and Calibration	Standard	Factory Std	Single Calibration	A	*	*	*
	Standard	Custom (Unit Data Required)	Single Calibration	B	*	*	*
	High Accuracy	Factory Std	Single Calibration	E	**s**	**s**	**s**
	High Accuracy	Custom (Unit Data Required)	Single Calibration	F	**s**	**s**	**s**

TABLE VII	ACCESSORY SELECTIONS					
	Bracket Type	**Material**				
a. Mounting Bracket	None	None	0 _ _ _	*	*	*
	Angle Bracket	Carbon Steel	1 _ _ _	*	*	*
	Angle Bracket	304 SS	2 _ _ _	*	*	*
	Angle Bracket	316 SS	3 _ _ _	*	*	*
	Marine Approved Bracket	Carbon Steel	8 _ _ _	*	*	*
	Marine Approved Bracket	304 SS	4 _ _ _	*	*	*
	Flat Bracket	Carbon Steel	5 _ _ _	*	*	*
	Flat Bracket	304 SS	6 _ _ _	*	*	*
	Flat Bracket	316 SS	7 _ _ _	*	*	*
b. Customer Tag	**Customer Tag Type**					
	No customer tag		_ 0 _ _	*	*	*
	One Wired Stainless Steel Tag (Up to 4 lines 26 char/line)		_ 1 _ _	*	*	*
	Two Wired Stainless Steel Tag (Up to 4 lines 26 char/line)		_ 2 _ _	*	*	*
c. Unassembled Conduit Plugs & Adapters	**Unassembled Conduit Plugs & Adapters**					
	No Conduit Plugs or Adapters Required		_ _ A0	*	*	*
	1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter		_ _ A2	**n**	**n**	**n**
	1/2 NPT 316 SS Certified Conduit Plug		_ _ A6	**n**	**n**	**n**
	M20 316 SS Certified Conduit Plug		_ _ A7	**m**	**m**	**m**
	Minifast® 4 pin (1/2 NPT) (not suitable for X-Proof applications)		_ _ A8	**n**	**n**	**n**
	Minifast® 4 pin (M20) (not suitable for X-Proof applications)		_ _ A9	**m**	**m**	**m**

TABLE VIII	OTHER Certifications & Options: (String in sequence comma delimited (XX, XX, XX,….)						
Certifications & Warranty	None - No additional options		00	*	*	*	
	NACE MR0175; MR0103; ISO15156 (FC33338) Process wetted parts only		FG	*	*	*	b
	NACE MR0175; MR0103; ISO15156 (FC33339) Process wetted and non-wetted parts		F7	**c**	**c**	**c**	
	Marine (DNV, ABS, BV, KR, LR)		MT	d	d	d	
	EN10204 Type 3.1 Material Traceability (FC33341)		FX	*	*	*	
	Certificate of Conformance (F3391)		F3	*	*	*	b
	Calibration Test Report & Certificate of Conformance (F3399)		F1	*	*	*	
	Certificate of Origin (F0195)		F5	*	*	*	
	FMEDA (SIL 2/3) Certification (FC33337)		FE	**j**	**j**	**j**	
	Over-Pressure Leak Test Certificate (1.5X MAWP) (F3392)		TP	*	*	*	
	Cert Clean for O_2 or CL_2 service per ASTM G93		OX	**e**	**e**	**e**	
	PMI Certification1		PM	*	*	*	
	Extended Warranty Additional 1 year		01	*	*	*	b
	Extended Warranty Additional 2 years		02	*	*	*	
	Extended Warranty Additional 3 years		03	*	*	*	
	Extended Warranty Additional 4 years		04	*	*	*	

TABLE IX	Manufacturing Specials				
Factory	Factory Identification	0000	*	*	*

MODEL RESTRICTIONS

Restriction Letter	Available Only with		Not Available with	
	Table	Selection(s)	Table	Selection(s)
a			VIII	F7, FG
b	Select only one option from this group			
c	1d	_ _ _ N,K,D,B _ _ _	Ia	D,H,K,L _ _ _ _ _ _
d	IV a	C, D,G,H _ _	VIIa	1,2,3,5,6,7 _ _ _
e	Ib	_ 2 _ _ _ _ _		
h			Ie	4, 5, 6
			VIIa	1,2,3,4,5,6,7,8 _ _ _
j	IVb	_ H _	Vb	_ 1,2 _
m	IV a	B, D, F, H _ _		
n	IV a	A, C, E, G _ _		
p			III	B- No CRN number available
s	I a	A, E _ _ _ _ _ _		
t			Ia	J, K, L _ _ _ _ _ _
u	IVb	_ H _		

[1]The PM option is available on all Smartline Pressure Transmitter process wetted parts such as process heads, flanges, bushings and vent plugs except plated carbon steel process heads and flanges. PM option information is also available on diaphragms except STG and STA in-line construction pressure transmitters.

FIELD INSTALLABLE REPLACEMENT PARTS

Description	Kit Number	Price
Integrally Mounted Basic Indicator Kit (Compatible with all Electronic Modules)	50049911-501	Note P
Terminal Strip w/Lightning Protection Kit for HART or DE Modules	50075472-532	Note P
Terminal Strip w/Lightning Protection Kit for FFB Module	50075472-534	Note P
Terminal Strip w/o Lightening Protection FFB Module	50075472-533	Note P
Terminal Strip w/o Lightening Protection for HART or DE Modules	50075472-531	Note P
HART Electronics Module	50049849-501	Note P
HART Electronics Module w/connection for external configuration buttons	50049849-502	Note P
DE Electronics Module	50049849-503	Note P
DE Electronics Module w/connection for external configuration buttons	50049849-504	Note P
FFB Electronics Module Kit	50049849-509	Note P
FFB Electronics Module w/connection for external configuration buttons	50049849-510	Note P
Standard Display Module	50126003-501	Note P

Note P - For part number pricing please refer to WEB Channel

PRODUCT MANUALS

Description	Part Number
Product Manual ST 700 Smart Transmitter User Manual - English	34-ST-25-44
Product Manual ST 700 Smart Transmitter HART/DE Communications Manual - English	34-ST-25-47
Product Manual ST 700 Smart Transmitter Safety Manual - English	34-ST-25-37
Product Manual ST 700 Smart Transmitter Foundation Fieldbus Manual - English	34-ST-25-48
Product Manual ST 700 Smart Transmitter Function Block Manual - English	34-ST-25-49

All product documentation is available at www.process.honeywell.com.

Sales and Service

For application assistance, current specifications, ordering, pricing, and name of the nearest Authorized Distributor, contact one of the offices below.

ASIA PACIFIC
Honeywell Process Solutions,
Phone: + 800 12026455 or
+44 (0) 1202645583
(TAC) **hfs-tac-support@honeywell.com**

Australia
Honeywell Limited
Phone: +(61) 7-3846 1255
FAX: +(61) 7-3840 6481
Toll Free 1300-36-39-36
Toll Free Fax:
1300-36-04-70

China – PRC - Shanghai
Honeywell China Inc.
Phone: (86-21) 5257-4568
Fax: (86-21) 6237-2826

Singapore
Honeywell Pte Ltd.
Phone: +(65) 6580 3278
Fax: +(65) 6445-3033

South Korea
Honeywell Korea Co Ltd
Phone: +(822) 799 6114
Fax: +(822) 792 9015

EMEA
Honeywell Process Solutions,
Phone: + 800 12026455 or
+44 (0) 1202645583

Email: (Sales)
FP-Sales-Apps@Honeywell.com
or
(TAC)
hfs-tac-support@honeywell.com

Web
Knowledge Base search
engine **http://bit.ly/2N5Vldi**

AMERICAS
Honeywell Process Solutions,
Phone: (TAC) (800) 423-9883
or (215) 641-3610
(Sales) 1-800-343-0228

Email: (Sales)
FP-Sales-Apps@Honeywell.com
or
(TAC)
hfs-tac-support@honeywell.com

Web
Knowledge Base search
engine **http://bit.ly/2N5Vldi**

Specifications are subject to change without notice.

www.fluidic-ltd.co.uk

For more information
To learn more about SmartLine Pressure Transmitters visit **www.process.honeywell.com**
Or contact your Honeywell Account Manager

Process Solutions
Honeywell
1250 W Sam Houston Pkwy S
Houston, TX 77042

Honeywell Control Systems Ltd
Honeywell House, Skimped Hill Lane
Bracknell, England, RG12 1EB

Shanghai City Centre, 100 Jungi Road
Shanghai, China 20061

www.process.honeywell.com

34-ST-03-101
March 2024
©2024 Honeywell International Inc.